

VOLVO CONSTRUCTION EQUIPMENT MATRIS REPORT

Machine model L120H	SerialNo 632409	Operating Hours 0	Reading Date 04/09/2020
Company name ALTA EQUIPMENT COMPANY	Dealer	Report Issuer	
Contact name	Technician clayton perry	Primary Application Light material handling	
Site	Workorder	Ground Condition	

MATRIS Reading, Summary / Recommendation




Machine model	SerialNo	Operating Hours	Reading Date
L120H	632409	0	04/09/2020

Main equipment	Type	Equipment
	Tyre size/class	
	Main Attachment	
	Extra Counterweight	
	Ballast	
	Chains	
	Boom Suspension System	
	Attachment Interface	
	Volume m3 (yd3) / Area m2 (ft2)	
	Attachment make	



Machine model	SerialNo	Operating Hours	Reading Date
L120H	632409	0	04/09/2020

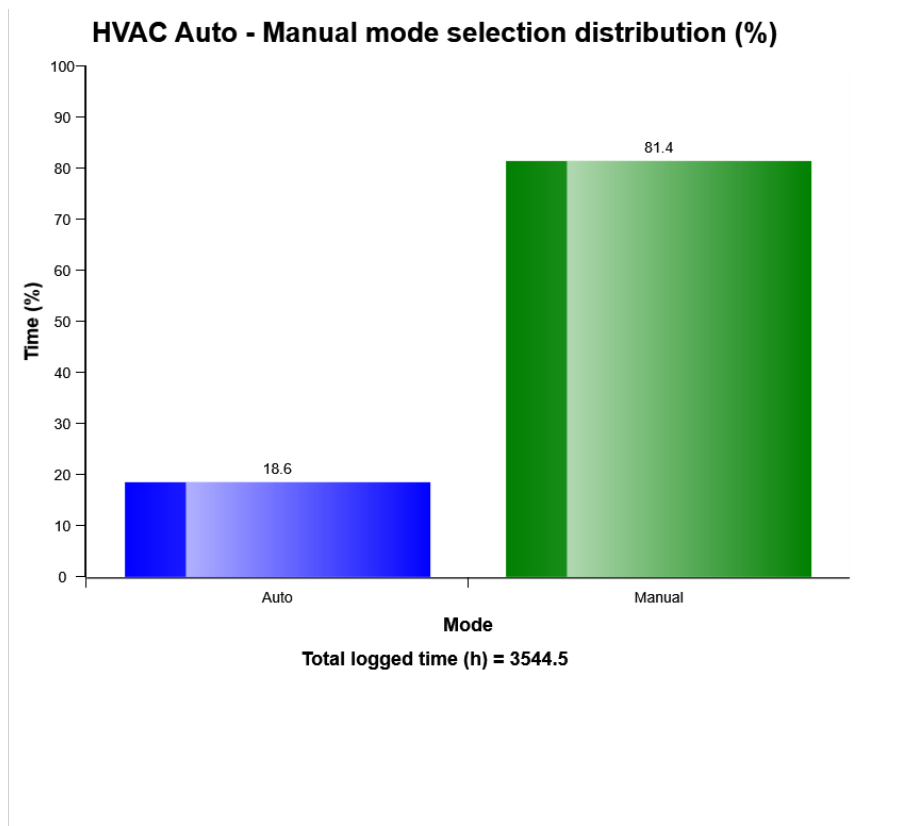


Definition:

The diagram describes auto-manual mode selection distribution of HVAC system in machine while it Works. The share of each mode compared to Total time of HVAC operation is displayed.



Machine model	SerialNo	Operating Hours	Reading Date
L120H	632409	0	04/09/2020

HVAC air temperature setting in auto control mode distribution (h)

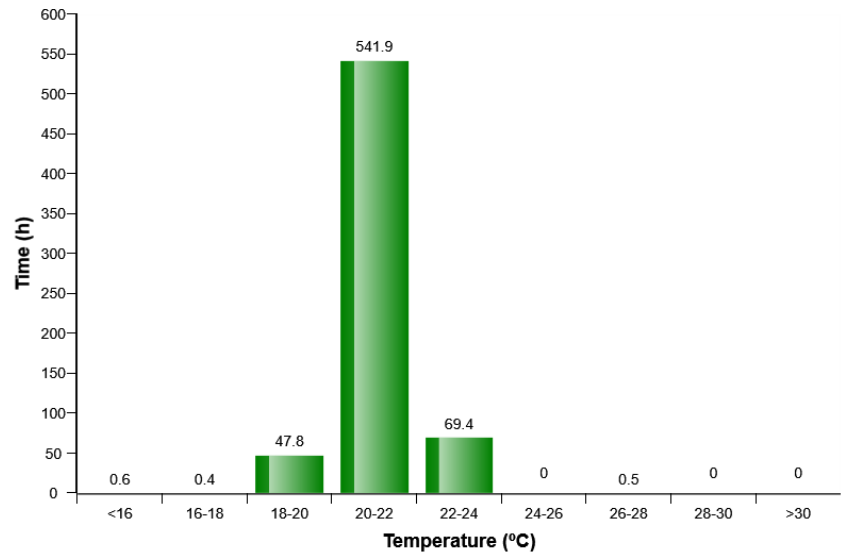


Definition:

The diagram describes air temperature setting distribution for HVAC auto control mode established by operator in Cabin



Machine model	SerialNo	Operating Hours	Reading Date
L120H	632409	0	04/09/2020

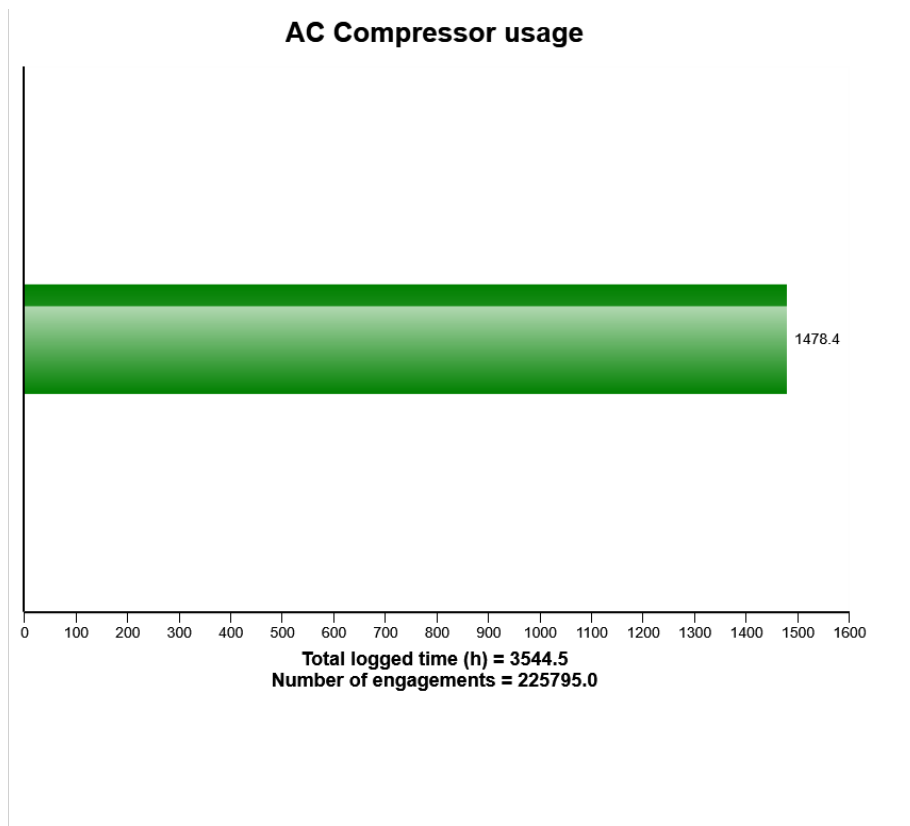

Definition:

The graph shows the total time of AC compressor engagement.

Explanation:

Green bar: Total time in hours, AC compressor has been engaged.

Under the graph the total engine running time (in hours) is displayed.

Total number of AC compressor activations is also displayed.




Machine model	SerialNo	Operating Hours	Reading Date
L120H	632409	0	04/09/2020

-



Machine model	SerialNo	Operating Hours	Reading Date
L120H	632409	0	04/09/2020

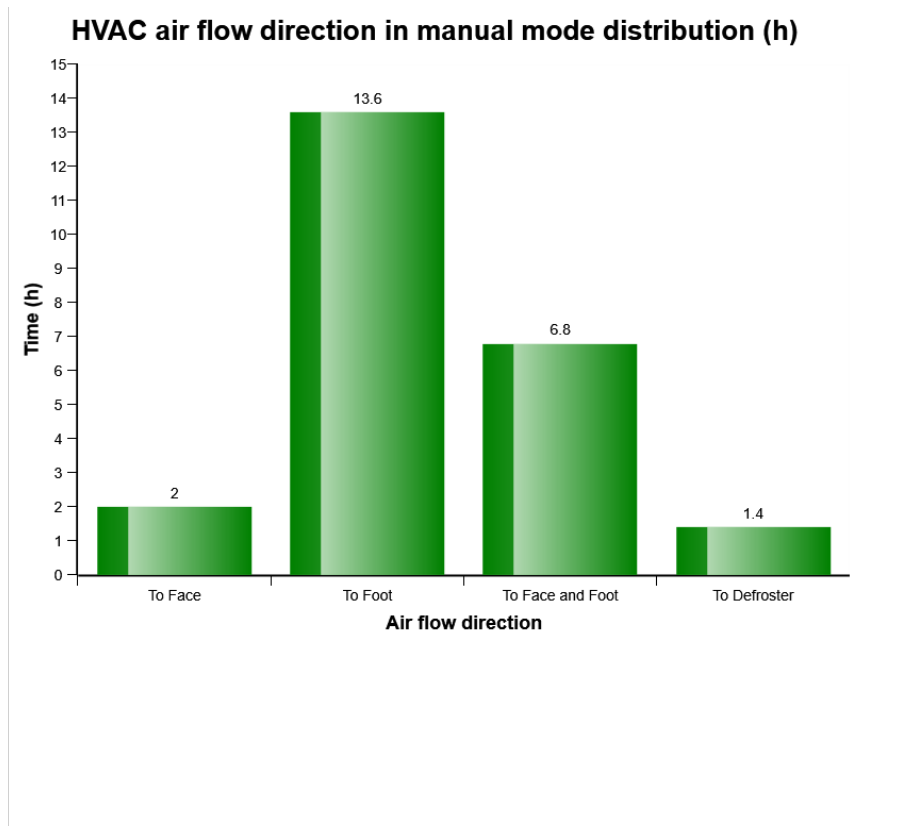


Definition:

The diagram describes air flow direction distribution for HVAC manual control mode established by operator in Cabin.



Machine model	SerialNo	Operating Hours	Reading Date
L120H	632409	0	04/09/2020

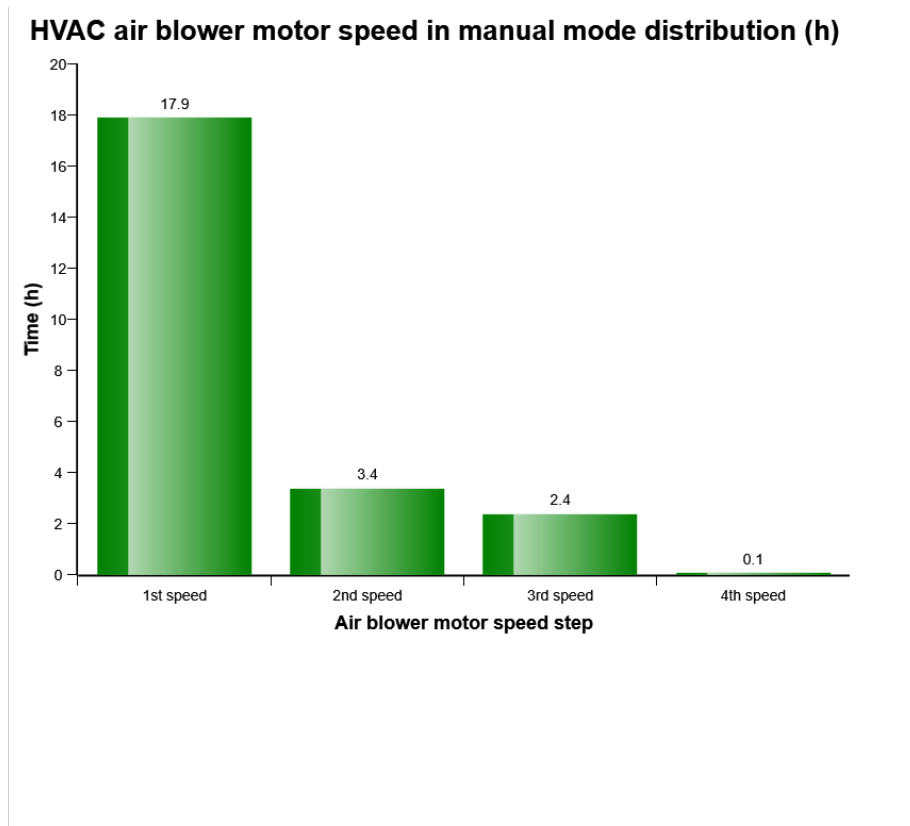

Definition:

The diagram describes air blower motor speed distribution for HVAC manual control mode established by operator in Cabin.

